






< Figure 1 > Loosening the ground straps.

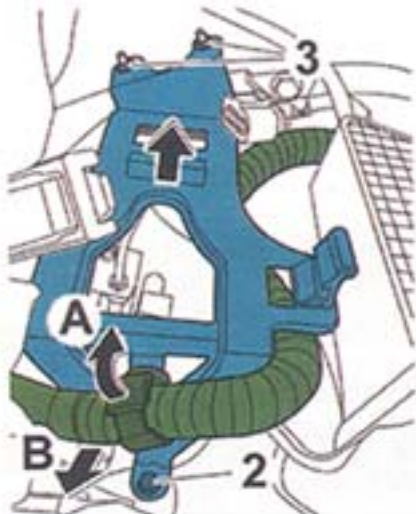


< Figure 2 > Removing support for the DME control module.

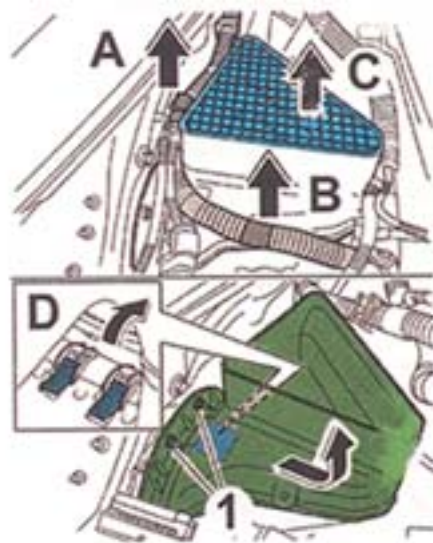


< Figure 3 > Removing intake pipe on the heating/fresh air unit.

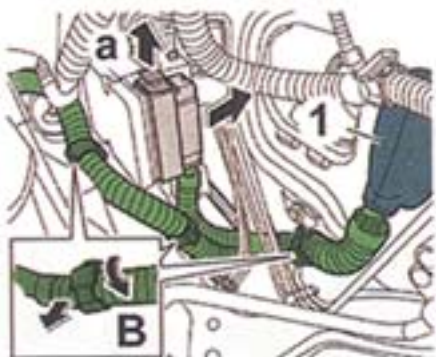

< Figure 4 > Pulling off the PSM control unit connector.

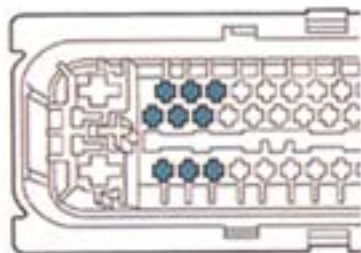

< Figure 5 > Examining the PSM control unit for traces of corrosion.

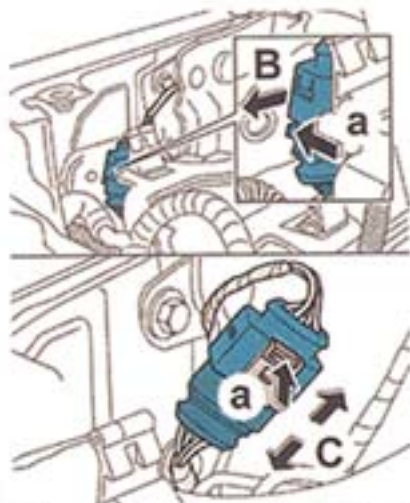

< Figure 6 > Disconnecting the hood wire harness plug connection.